


### 3. Dimensions

#### 3.1 Dimensional Drawings

ZRUN040GSS0 / ZRUN050GSS0 / ZRUN060GSS0

ZRUN040LSS0 / ZRUN050LSS0 / ZRUN060LSS0

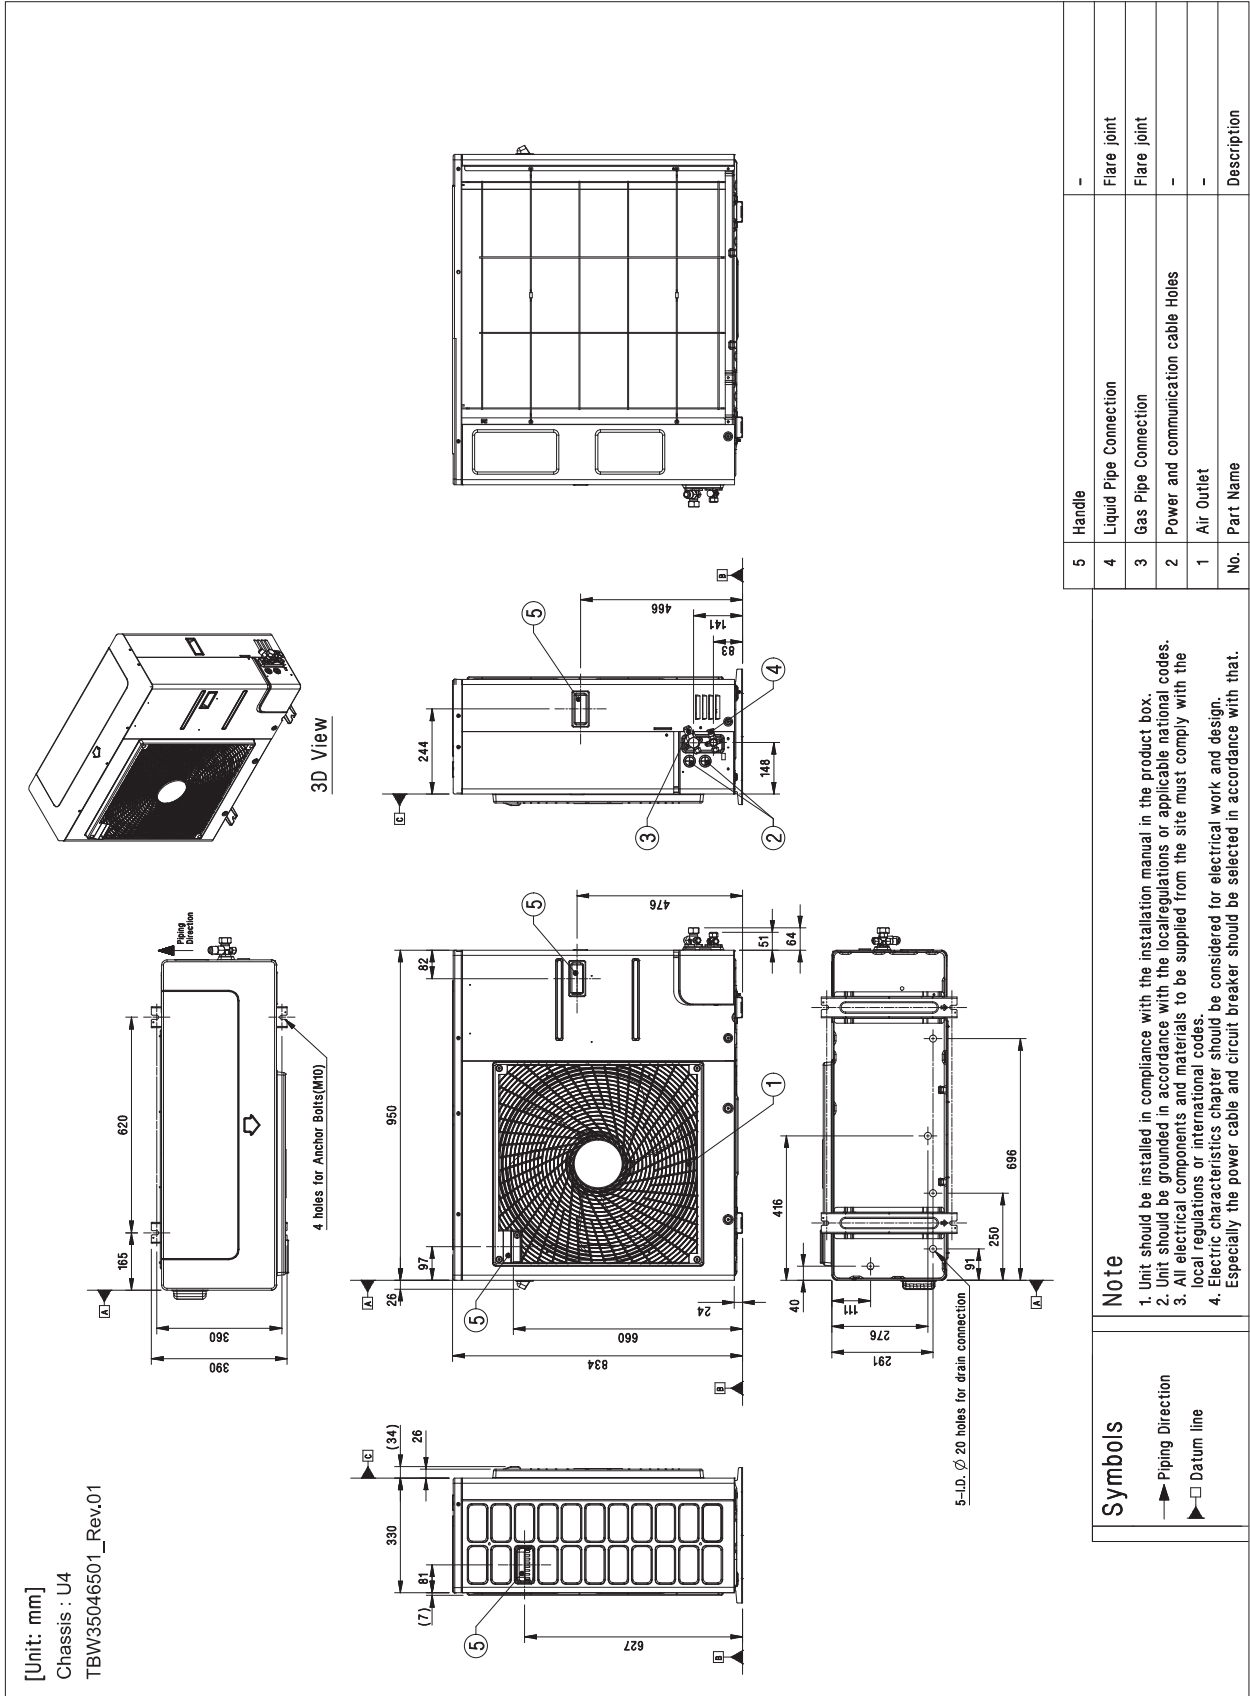

**Symbols**

- Piping Direction
- ▲ Datum line

**Note**

1. Unit should be installed in compliance with the installation manual in the product box.
2. Unit should be grounded in accordance with the local regulations or applicable national codes.
3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
4. Electric characteristics chapter should be considered for electrical work and design. Especially the power cable and circuit breaker should be selected in accordance with that.

| No. | Part Name                           | Description |
|-----|-------------------------------------|-------------|
| 5   | Handle                              | -           |
| 4   | Liquid Pipe Connection              | Flare joint |
| 3   | Gas Pipe Connection                 | Flare joint |
| 2   | Power and communication cable Holes | -           |
| 1   | Air Outlet                          | -           |